

SIZING A PRESSURE TANK

The functions of a pressure tank are to:

1. Protect and prolong the life of the pump by preventing rapid cycling of the pump motor;
2. Provide water under pressure for delivery between pump cycles; and
3. Provide additional water storage under pressure to assist the pump in meeting the total demands of a system if the pump or well is incapable of supplying the required capacity.

Selecting a Pressure Tank

When selecting a pressure tank, certain information must be known:

1. System demand;
2. Pump capacity; and
3. Well capacity.

The **system demand** is a function of water usage and location, expressed as gallon(s) per minute (gpm) and pound(s) per square inch gauge (psig), respectively. Usage or flow (gpm) can be determined using one of several methods (refer to Table I.3.1 for typical demands):

- a. The fixture method determines the system demand by totaling the number of fixtures in the home, including outside hose bibs, and multiplying this number by 1 gallon per minute (gpm). For example, 10 fixtures x 1 gpm = 10 gpm.
- b. The peak demand method determines system demand considering that more than one fixture will be in use under peak demand. The number of fixtures being used at the same time is determined and multiplied by 3 gpm. For example, 4 fixtures x 3 gpm = 12 gpm.
- c. An alternate method determines system demand by calculating the number of bathrooms (half baths are considered as 1) and multiplying by 4 gpm. For a home with 2 ½ bathrooms, multiply 3 x 4 gpm = 12 gpm.

Use the largest system demand determined by the above methods. For determining system demand for water systems supplying farms, and public or commercial buildings such as schools or motels, see our *Water Systems Handbook*.

Table I.3.1

Average Water Consumption for Home and Farm Use

PRIVATE RESIDENCES

Outlets	Flow Rate GPM	Total Usage Gallons	Bathrooms in Home			
			1	1½	2-2½	3-4
Shower or Bathtub	5	35	35	35	53	70
Lavatory	4	2	2	4	6	8
Toilet	4	5	5	10	15	20
Kitchen Sink	5	3	3	3	3	3
Automatic Washer	5	35	–	18	18	18
Dishwasher	2	14	–	–	3	3
Normal seven minute* peak demand (gallons)			45	70	98	122
Minimum sized pump required to meet peak demand without supplemental supply	Divide peak demand by 7		7 GPM (420 GPH)	10 GPM (600 GPH)	14 GPM (840 GPH)	17 GPM (1020 GPH)

Notes:

Values given are average and do not include higher or lower extremes.

* Peak demand can occur several times during morning and evening hours.

** Count the number of fixtures in a home including outside hose bibs. Supply one gallon per minute each.

YARD FIXTURES

Garden Hose – ½"	3 GPM
Garden Hose – ¾"	6 GPM
Sprinkler– Lawn	3-7 GPM

FARM USE

Horse, Steer	12 Gallons per day
Dry Cow	15 Gallons per day
Milking Cow	35 Gallons per day
Hog	4 Gallons per day
Sheep	2 Gallons per day
Chickens/100	6 Gallons per day
Turkeys/100	20 Gallons per day
Fire	20-60 GPM

Alternate Capacity Method:

Calculate the number of bathrooms x 4 gpm = ?
(Note that 1/2 baths are considered as full baths.)

NOTE: Seven minutes is used here as an example of peak demand time, which may actually be longer or shorter.

The **pump capacity** should be selected according to the system demand. If a pump exists, the capacity must be determined.

The **well capacity** should be documented when the well has been declared ready for use and will often be referred to in gallons per hour (gph). If the well capacity is unknown, it should be determined by measuring the well water level. The water level must be lowered via pumping, measured, then allowed to recover to the static water level. A record of the time required to return to static water level along with the well pipe size can be used to calculate the well capacity (recovery). An alternate method of determining if the well capacity is sufficient for system demand is to draw water from the well at or above the peak demand and determine if the well can sustain the peak demand flow.

A typical water system will have adequate **well capacity** and **pump capacity** to meet or exceed the **system demand**. The system will commonly function using a differential pressure switch to control the system pressure at or above the minimum required system pressure.

Total Tank Volume

Selecting the pressure tank total volume for typical systems will consider the pump capacity. Total tank volume is not a measure of tank acceptance volume, which is typically considered to be available water volume or tank drawdown. Total tank volume is a measure of the total tank size required to provide the required available water. The total tank volume will vary depending on tank type.

- Referring to Table IV.1.2, select the pump capacity, tank type and pressure switch settings to determine the total tank volume.
- When it is desired to have a pressure switch setting different from those included in the table, the total tank volume can be determined as follows:

$$\text{Total Tank Volume} = \frac{\text{Minimum Drawdown (from Table IV. 1. 2)}}{\text{Acceptance Factor}}$$

(Acceptance Factor is the factor of the total tank volume that will provide available water).

Acceptance Factor is calculated using the pressure tank precharge pressure (2 psig below the pump cut-in pressure). The pressure tank will operate between the pressures set by the pressure switch. The tank precharge pressure should be set at 2 psig below the low pressure cut-in to prevent a noticeable drop in pressure at the fixture.

$$\text{Acceptance Factor} = 1 - \frac{((P1 \text{ cut in} - 2) + 14.7)}{(P2 \text{ cut out} + 14.7)}$$

TABLE IV.1.2

SAMPLE TANK SELECTION CHART – MINIMUM TANK VOLUME FOR PROPER MOTOR LIFE
(based on present industry practices)


PUMP CAPACITY		MINIMUM DRAWDOWN (1) (Gallons)	TOTAL TANK VOLUME (GALLONS)								
			20-40			30-50			40-60		
			A*	B*	C*	A*	B*	C*	A*	B*	C*
240	4	4	10	15	25	15	15	40	15	15	55
300	5	5	15	15	30	15	20	50	20	20	70
360	6	6	15	20	40	20	20	60	20	25	85
420	7	7	20	20	45	25	25	70	25	30	100
480	8	8	20	25	50	25	25	80	30	30	110
540	9	9	25	25	60	30	30	90	35	35	125
600	10	10	30	30	65	30	35	100	40	40	140
660	11	12	35	35	80	40	40	120	45	45	165
720	12	13	35	40	85	40	45	130	50	50	180
780	13	15	40	45	100	50	50	150	55	60	210
840	14	17	45	50	110	55	55	170	65	65	235
900	15	19	50	55	125	60	65	190	70	75	265
960	16	20	55	55	130	65	65	200	75	75	280
1020	17	23	65	65	150	75	75	230	85	90	320
1080	18	25	70	70	160	80	85	250	95	95	350
1140	19	27	75	75	175	85	90	270	100	105	375
1200	20	30	80	85	195	95	100	300	110	115	415
1260	21	33	90	90	215	105	110	330	125	125	460
1320	22	36	100	100	235	115	120	360	135	135	500
1380	23	38	105	105	245	125	125	380	140	145	530
1440	24	41	110	115	265	135	135	410	155	155	570
1500	25	44	120	120	285	140	145	440	165	165	610
1560	26	47	130	130	305	150	155	470	175	180	655
1620	27	50	135	140	325	160	165	500	185	190	700
1680	28	53	145	145	345	170	175	530	200	200	735
1740	29	57	155	160	370	185	185	570	215	215	790
1800	30	60	165	165	390	195	195	600	225	225	835

A* – Bladder or Diaphragm Tank Design B* – Floating Wafer Tank Design C* – Plain Steel Tank Design
(1) NOTE: Actual values may vary somewhat with field conditions.

See VDF pump manufacturers for tank sizing.

When the Well or Pump Cannot Meet Peak Demand

In cases where the well cannot meet the peak system demand, additional pump protection may be required in the form of floats or power monitors. For more information on low-producing wells, reference the *Water Systems Handbook*.

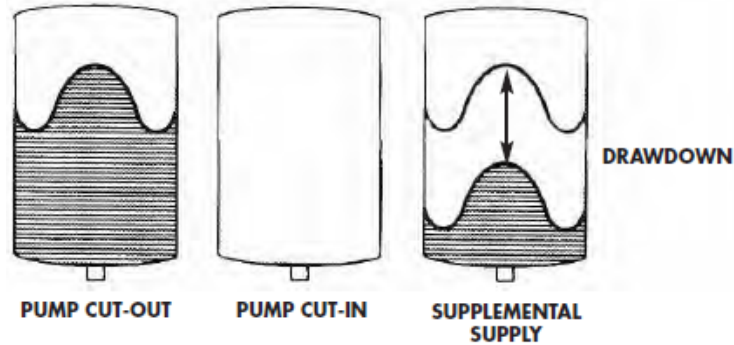

In cases where the pump cannot meet the peak system demand, a supplemental drawdown may be obtained from the pressure tank. (See figure above). Supplemental drawdown can be added to the pressure tank by adjusting the tank and system pressures in order to supplement the system during times of peak demand. When the pump can meet the system demand, it will operate between the pressure switch settings. When the pump cannot meet the system demand, the pressure will drop below the cut-in pressure. The supplemental drawdown is supplied by the tank at a pressure between the tank precharge and the cut-in pressure.

The supplemental drawdown required is determined from peak demand:

$$\text{Supplemental Drawdown (Gallons)} = [\text{Peak Demand (gpm)} - \text{Pump Capacity (gpm)}] * [\text{Peak Demand Time (minutes)}]$$

The total required drawdown is determined by referring to Table IV.1.2 to obtain the minimum drawdown:

$$\text{Total Required Drawdown (Gallons)} = [\text{Minimal Drawdown} + \text{Supplemental Drawdown}]$$

$$\text{Total Tank Volume} = \frac{\text{Total Drawdown}}{\text{Acceptance Factor}}$$

where the

$$\text{Acceptance Factor} = 1 - \frac{(\text{P1 pressure tank precharge} + 14.7)}{(\text{P2 cut out} + 14.7)}$$

Consult the manufacturer for additional assistance in determining proper tank sizing and pressure settings.

For more information on sizing a pressure tank see our *Water Systems Handbook*.

For More Information on Sizing a Pressure Tank

Contact your licensed well contractor, the tank manufacturer, or the [wellcare®](#) Hotline.



Information to help maintain and protect your water well system:

[wellcare®](#) is a program of the [Water Systems Council \(WSC\)](#). WSC is the only national organization solely focused on protecting the health and water supply of an estimated 23 million households nationwide who depend on private wells (according to the U.S. EPA).

This publication is one of more than 100 [wellcare®](#) information sheets available FREE at www.watersystemscouncil.org.

Well owners and others with questions about wells and well water can contact the [wellcare®](#) Hotline at 1-888-395-1033 or visit www.wellcarehotline.org to fill out a contact form or chat with us live!

JOIN THE WELLCARE® WELL OWNERS NETWORK!

By joining the FREE [wellcare®](#) Well Owners Network, you will receive regular information on how to maintain your well and protect your well water.

Contact us at 1-888-395-1033 or visit www.wellcarehotline.org to join!